

Date _____

Order no. _____

System layout

Type MCS20i, MCS40i & MCS80i

For Twin Heat only

No. _____

Deliv. week _____

Sign. _____

Ordered By: _____

Delivery Address: _____

Address: _____

Address: _____

Phone: _____

Phone: _____

Mail: _____

Mail: _____

Freight:

Delivered ☐Pick up ☐Other ☐

Type: MCS20i ☐ MCS40i ☐ MCS80i ☐ 1x 230V + PE ☐ 3 x 400V + N + PE ☐

Rotag 2500 ☐ Quatro I ☐ Single Stoker ☐ Single Boiler ☐ Boiler exchange ☐ Boilerdoor without airlock ☐

Rotag 4500 ☐ Quatro II ☐ Connection kit 225 ☐ Cooling coil w. valve ☐

Accessories: Draught stabilizer ☐ 3-way shuntvalve Honeywell ☐ Esbe 1" locked ☐ Motorvalve dim. ☐

Aut. cleaning system ☐ Compressor ☐ Prepared for deashing ☐ Ash ejector ☐

Ash transport auger 1,5m ☐ Ash transport auger 2,5m ☐ Ash storage 110L ☐

Burnertube scraber Linak* ☐ After mounted burnertube scraber Belimo ☐ GSM alarm ☐

*for ME40i and ME80i exclusively

Smoke pipes:

MCS20i - Ø155 ☐ Elbow 90° w. cap - pcs. _____ Straight 500mm - pcs. _____ Wall bushing - pcs. _____

MCS40i - Ø187 ☐ Elbow 45° w. cap - pcs. _____ Piping insulation 1000mm - pcs. _____ Chimney _____

MCS80i - Ø215 ☐

Layout of the plant:

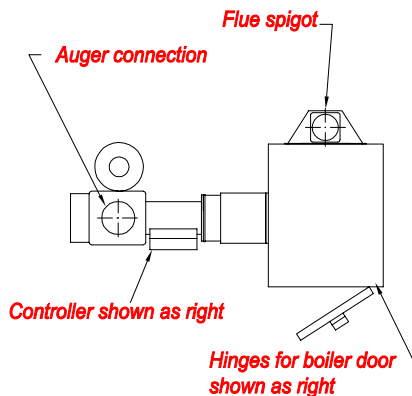
Please decide the layout 1, 2, 3 or 4 and the placing of controller and boiler door hinges.

Layout 1 ☐

Hinges for boiler door:

Right ☐Left ☐

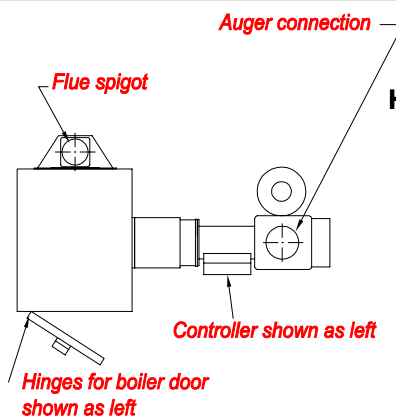
Controller:

Right ☐Left ☐Layout 2 ☐

Hinges for boiler door:

Right ☐Left ☐

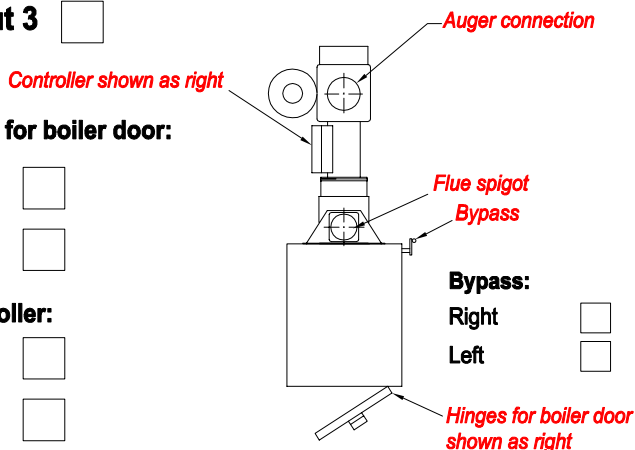
Controller:

Right ☐Left ☐Layout 3 ☐

Hinges for boiler door:

Right ☐Left ☐

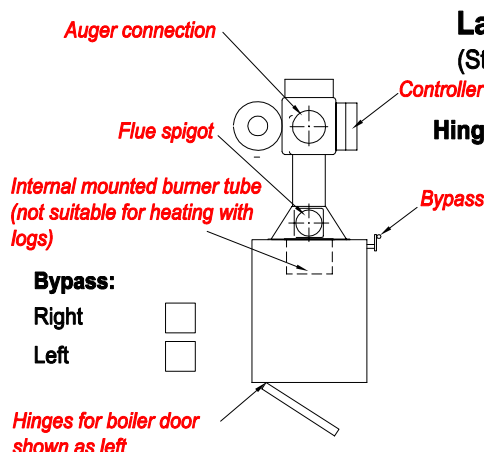
Controller:

Right ☐Left ☐Layout 4 ☐
(Stoker heating only)

Hinges for boiler door:

Right ☐Left ☐

Controller:

Right ☐Left ☐

TWINHEAT®

Phone +45 98645222

E-mail twinheat@twinheat.dk

We reserve the rights to make changes Januar 2024