

Date _____

Order no. _____

System layout Type CS

For Twin Heat only

No. _____ / _____

Deliv. week _____

Sign. _____

Ordered By: _____

Delivery Address: _____

Address: _____

Address: _____

Phone: _____

Phone: _____

Mail: _____

Mail: _____

Freight:

Delivered ☐Pick up ☐Other ☐
 Type: CS120i ☐ CS150i ☐ CS250i ☐ 1x 230V + PE ☐ 3 x 400V + N + PE ☐

 Rotag 2500 ☐ Quatro I ☐ Connection kit 160 ☐ Connection kit 180 ☐ Small storage ☐

 Rotag 4500 ☐ Quatro II ☐ Connection kit 160/150 ☐ Connection kit 225 ☐ Draught stabilizer (big) ☐

Accessories:

Motorvalve dim. _____

Aut. cleaning system ☐Compressor ☐GSM alarm ☐Ash ejector ☐Ash transport auger 1,5m ☐Ash transport auger 2,5m ☐Ash storage 110L ☐

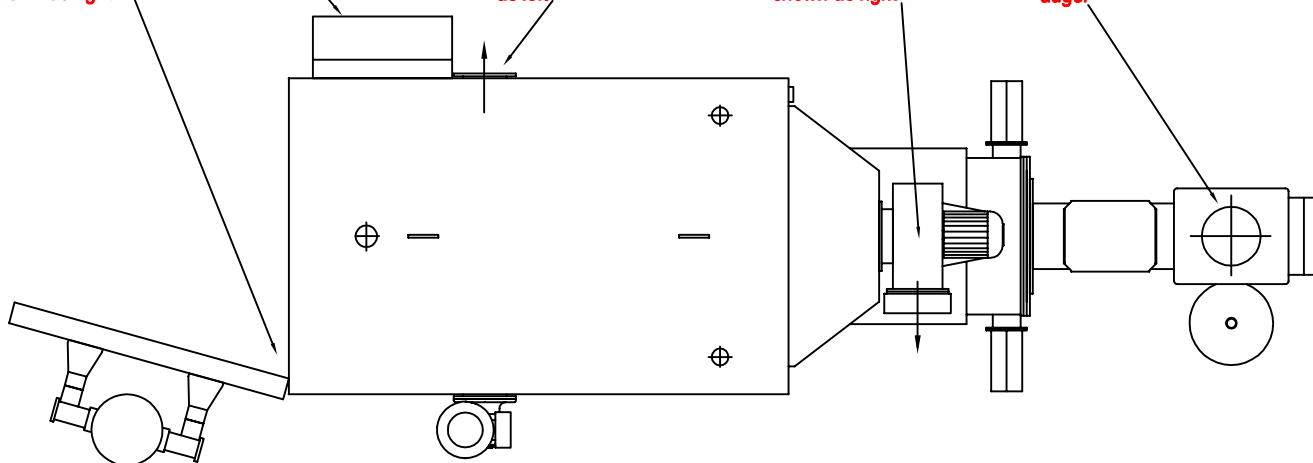
Smoke pipes:

 Ø200 ☐ Elbow 90° w. cap - pcs. _____ Straight 500mm - pcs. _____ Wall bushing - pcs. _____

 Ø215 ☐ Elbow 45° w. cap - pcs. _____ Piping insulation 1000mm - pcs. _____

 Ø250 ☐

Please decide which side of boiler the boilerdoor-hinges, cleaning door hinges, controller, deashing outlet and fluegas fan outlet are to be placed and the size of connecting branch for auger.

Hinges for boiler door
shown as rightController shown as
leftDeashing outlet shown
as leftFluegas fan outlet
shown as rightConnecting branch for
auger

Left

Right

Up

Hinges for boiler door

☐☐

Hinges for cleaning door

☐☐

Controller

☐☐

Deashing outlet

☐☐

Fluegas fan outlet

☐

Connecting branch for auger

160mm ☐180mm ☐225mm ☐
TWINHEAT®

Phone +45 98645222

E-mail twinheat@twinheat.dk

We reserve the rights to make
changes - Juli 2023